

# Tech Spec Guide



**icpi**

Interlocking Concrete  
Pavement Institute®

## Your requested ICPI Tech Spec 17 follows this page.

Design and Installation Professionals frequently turn to interlocking concrete pavements and permeable interlocking concrete pavements because they offer lower initial and life cycle costs and provide environmentally sustainable solutions.

ICPI provides resources for ICP and PICP design, construction, and maintenance. These include: Tech Specs, Guide Specs, Detail Drawings, Construction Tolerance Guides, Fact Sheets, Design Manuals and design software. ICPI also offers several relevant continuing education courses at [icpi.org](http://icpi.org) and [aecdaily.com](http://aecdaily.com)

### Find the right guide for your location.

Many ICPI members subscribe by state or province to this Tech Spec service to support the development and revision of these technical documents. The ICPI website Technical Center offers the opportunity to select Tech Specs by state or province.

This ICPI  
Tech Spec is  
provided  
courtesy of



<https://icpi.org/acker-stoneindustries>

### ICPI Tech Spec Library

---

- **Tech Spec 1:** Glossary of Terms for Segmental Concrete Pavement
- **Tech Spec 2:** Construction of Interlocking Concrete Pavements
- **Tech Spec 3:** Edge Restraints for Interlocking Concrete Pavements
- **Tech Spec 4:** Structural Design of Interlocking Concrete Pavement for Roads and Parking Lots
- **Tech Spec 5:** Cleaning, Sealing and Joint Sand Stabilization of Interlocking Concrete Pavement
- **Tech Spec 6:** Reinstatement of Interlocking Concrete Pavements
- **Tech Spec 7:** Repair of Utility Cuts Using Interlocking Concrete Pavements
- **Tech Spec 8:** Concrete Grid Pavements
- **Tech Spec 9:** Guide Specification for the Construction of Interlocking Concrete Pavement
- **Tech Spec 10:** Application Guide for Interlocking Concrete Pavements
- **Tech Spec 11:** Mechanical Installation of Interlocking Concrete Pavements
- **Tech Spec 12:** Snow Melting Systems for Interlocking Concrete Pavements
- **Tech Spec 13:** Slip and Skid Resistance of Interlocking Concrete Pavements
- **Tech Spec 14:** Concrete Paving Units
- **Tech Spec 15:** A Guide for the Construction of Mechanically Installed Interlocking Concrete Pavements
- **Tech Spec 16:** Achieving LEED Credits with Segmental Concrete Pavement
- **Tech Spec 17:** Bedding Sand Selection for Interlocking Concrete Pavements in Vehicular Applications
- **Tech Spec 18:** Construction of Permeable Interlocking Concrete Pavement Systems
- **Tech Spec 19:** Design, Construction and Maintenance of Interlocking Concrete Pavement Crosswalks
- **Tech Spec 20:** Construction of Bituminous- Sand Set Interlocking Concrete Pavement
- **Tech Spec 21:** Capping and Compression Strength Testing Procedures for Concrete Pavers
- **Tech Spec 22:** Geosynthetics for Segmental Concrete Pavements
- **Tech Spec 23:** Maintenance Guide for Permeable Interlocking Concrete Pavements
- **Tech Spec 25:** Construction Guidelines for Segmental Concrete Paving Slabs and Planks in Non-Vehicular Residential Applications



## Bedding Sand Selection for Interlocking Concrete Pavements in Vehicular Applications

Bedding sands are a critical component of all sand-set segmental concrete paving systems. Especially for vehicular applications, specifiers and contractors need to consider bedding sand selection. While gradation is an important consideration, other characteristics should be assessed in order to ensure long-term pavement performance. This technical bulletin examines these characteristics and provides guidance to specifiers and contractors.

### Background

Bedding sand provides four main functions. It beds the pavers during installation; helps initialize interlock among the pavers; provides a structural component for the system (as described in *ICPI Tech Spec 4 Structural Design of Interlocking Concrete Pavement for Roads and Parking Lots*) and facilitates drainage of water that infiltrates through the joints. Typical specifications require bedding sands

to conform to ASTM C33 and CSA A23.1 FA1 gradation for concrete sands with additional limits on the allowable amount of material that passes the No. 200 (0.075 mm\*) sieve (See Table 1). In vehicular applications, experience and research have shown that other factors besides gradation contribute to the successful function of the bedding layer in vehicular applications. Knapton (1994) notes that since 1980 the amount of material passing the No. 200 (0.075 mm) sieve has been reduced in the British Standard BS 7533-1 (2001) *Guide for the Structural Design of Heavy Duty Pavements Constructed of Clay or Concrete Pavers*. He notes that fines have reduced from 10% in 1980, to 3% in 1991, to 1% for heavily trafficked pavements, further reducing to 0.1% for bus stations. North American standards currently limit the amount of allowable material passing these sieves to 1%.

Other studies (Lilley and Dowson 1988) (Beaty 1996)

ASTM C33		CSA A23.1 FA1	
Sieve Size	Percent Passing	Sieve Size	Percent Passing
3/8 in.(9.5 mm)	100	10.0 mm	100
No. 4 (4.75 mm)	95 to 100	5.0 mm	95 to 100
No. 8 (2.36 mm)	80 to 100	2.5 mm	80 to 100
No. 16 (1.18 mm)	50 to 85	1.25 mm	50 to 90
No. 30 (0.6 mm)	25 to 60	630 µm	25 to 65
No. 50 (0.3 mm)	5 to 30	315 µm	10 to 35
No. 100 (0.15 mm)	0 to 10	160 µm	2 to 10
No. 200 (0.075 mm)	0 to 1 <sup>1</sup>	80 µm	0 to 1 <sup>1</sup>

Note 1: Bedding sands should conform to ASTM C33 or CSA A23.1 FA1 gradations for concrete sand. For ASTM C33, ICPI recommends the additional limitations on the No. 200 (0.075 mm) sieve as shown. For CSA A23.1 FA1, ICPI recommends reducing the maximum passing the 80 µm sieve from 3% to 1%.

Table 1. Gradation for Bedding Sand

\*Although the ASTM equivalent for the No. 200 sieve size is 75 micron (.075 mm), CSA standards use the German (DIN) and French (ANFOR) standard equivalent sieve size of 80 micron (0.080 mm)

have investigated failures of segmental concrete pavements subjected to channelized vehicular traffic. They have also concluded that more comprehensive specifications are required. Lilley and Dowson (1988) suggested that bedding sands in segmental concrete pavements designed to carry more than 1.5 million equivalent standard axle loads, ESALs (18 kip/80 kN), should be subjected to grading and degradation tests. *For the purposes of this Tech Spec, vehicular traffic is defined as roads exposed to a minimum of 1.5 million lifetime ESALs and axle loads up to 24,250 lbs (11,000 kg).*

### Failure Mechanisms

Failure of the bedding sand layer occurs in channelized vehicular loads from two main actions; structural failure through degradation and saturation due to inadequate drainage. Since bedding sands are located high in the pavement structure, they are subjected to repeated applications of high stress from the passage of vehicles over the pavement (Beatty 1996). This repeated action, particularly from higher bus and truck axle loads, will degrade the bedding

sand and cause failure. For these applications sand should be selected based on their ability to withstand long-term degradation.

Bedding sand permeability also is a significant factor in the selection process. Wherever difficulties have been experienced with laying course materials in heavily trafficked pavements, water has been a major factor (Knapton 1994). As they approach higher moisture levels in service, bedding sands may become unstable. Smaller particle sizes (fines) become suspended in water, forming slurry that lubricates the entire bedding layer. Choosing bedding sand with a gradation as shown in Table 1 will help to reduce the risk of poor drainage and instability. However, these sands will be susceptible to drainage problems if they do not have the hardness to withstand long term degradation from vehicular wheel loads.

### Selection and Performance Design Principles— Going beyond gradation

**Selecting Durable Bedding Sands**—Durability of aggregates has long been understood to be a major factor in pavement performance. ASTM C 88 *Soundness of Aggregate by use of Sodium Sulfate or Magnesium Sulfate* (ASTM 2005) is an example of a typical test method used by road agencies to assess aggregate durability. The test involves soaking an aggregate in a solution of magnesium or sulfate salts and oven drying. This is repeated for a number of cycles, with each cycle causing salt crystals to grow and degrade the aggregate. The test method takes a minimum of 6 days to complete. The percent loss is then calculated on individual size fractions. This test method, however, is considered highly variable. Jayawickrama, Hossain and Phillips (2006) note that when ASTM initially adopted this test method they recognized the lack of precision, saying, “it may not be suitable for outright rejection of aggregates without confirmation from other tests more closely related to the specific service intended.” ICPI recommends using ASTM C 88 as a measure of aggregate durability as long as other material properties described in this bulletin are also considered.

The Micro-Deval test is evolving as the test method of choice for evaluating durability of aggregates in North America. Defined by CSA A23.2-23A, *The Resistance of Fine Aggregate to Degradation by Abrasion in the Micro-Deval Apparatus* (CSA 2004) and ASTM D 7428-08 *Standard Test Method for Resistance of Fine Aggregate to Degradation by Abrasion in the Micro-Deval Apparatus*, the test method involves subjecting aggregates to abrasive action from steel balls in a laboratory rolling jar mill. In the CSA test method a 1.1 lb (500 g) representative sample is obtained after washing to remove the No. 200 (0.080 mm) material. The sample is saturated for 24 hours and placed in the Micro-Deval stainless steel jar with 2.75 lb (1250 g) of steel balls and 750 mL of tap water (See Figure 1). The jar is rotated at 100 rotations per minute for 15 minutes. The sand is separated from the steel balls over a sieve and the sample of sand is then washed over an 80 micron (No. 200) sieve. The material retained on the 80 micron



Figure 1. The Micro-Deval test apparatus.  
Source: Gilson Company

sieve is oven dried. The Micro-Deval loss is then calculated as the total loss of original sample mass expressed as a percentage. ASTM and the American Association of State Highway Transportation Officials have both adopted the coarse aggregate version of the Micro-Deval test, ASTM D6928 (2006) and AASHTO TP 58. Both are also considering a version for fine aggregates. Since the test apparatus uses the same size drum and rotates at the same speed, no modifications to the apparatus are required to perform the fine aggregate test in laboratories currently equipped to perform the coarse aggregate test procedure.

A study conducted by the Interlocking Concrete Pavement Institute (ICPI 2004) investigated nine sands from across the United States reported by contractors to have “good to excellent” serviceability in vehicular applications. The results of this study indicated that eight of these sands had Micro-Deval degradation losses less than 8% when measured according to CSA A23.2-23A (CSA 2000). The same study subjected these sands to the ASTM C88 soundness loss and found that no sample had greater than 6% loss. The Micro-Deval test is recommended as the primary means to characterize bedding sand durability (See Table 3) and the magnesium or sulfate soundness should be considered when the Micro-Deval test is not locally available. The variability of the soundness test method should always be a consideration unless measured in relation to other material properties.

A test method similar in nature to Micro-Deval is the Lilley and Dowson test (Lilley Dowson 1998). This test method specifically developed for bedding sands is recognized internationally and is referenced in ICPI manuals *Port and Industrial Pavement Design with Concrete Pavers* (ICPI 1997) and *Airfield Pavement Design with Concrete Pavers* (ICPI 1995). This test method is performed on 3 lbs (1.4 kg) randomly selected, oven-dried sand samples with two 1 in. (25 mm) diameter steel balls together weighing 0.3 lb (135 g). Three sub-samples each weighing 0.5 lbs (0.2 kg) are derived from the main sample. Each sub-sample is sieved according to ASTM C 136 then re-mixed and placed in a nominal liter capacity porcelain jar with the two steel balls. The three jars are rotated at 50 rpm for six hours and sieved again. Sand durability is assessed from resulting increases in the percent passing the No. 50, 100 and 200 (0.300, 0.150, and 0.075 mm) sieves. Developed in the UK, the test is not readily available at laboratories in North America. The CSA and ASTM Micro-Deval tests may be more available.

Beaty (1996) demonstrated a correlation between the two tests with a correlation coefficient greater than 0.99. The relationship between the two tests is:

$$L = 1.97 + 1.21 M$$

Where:

M = CSA Micro-Deval Degradation Loss (%)

L = Lilley and Dowson Degradation Loss (%)

Beaty’s correlation involved a modification to the test procedure by reconstituting the test aggregates into a standard gradation shown in Table 2 and performing the Micro-Deval and Lilley Dowson tests on the re-graded aggregate. In this modified version of the Lilley Dowson test procedure the loss (L) is measured as the total increase in percentage of fines passing the No. 200 (0.075 mm) sieve at the completion of the test. Using the correlation described above, an 8% Micro Deval degradation (See Table 3) would have a corresponding Lilley and Dowson degradation of 12%.

**Bedding Layer Drainage**—Bedding layer drainage is important for early and long term performance of a pavement. One failure documented by Knapton (1993) describes a segmental pavement that was opened to bus traffic and within hours of construction subjected to continuous heavy rain. The bedding sand in this case had a high percentage of fines. As a result of the continuous rainfall, finer sieve fractions in the sand were transported into the drain holes of the underlying concrete slab. With the drainage compromised the bedding sand liquefied and was pumped through the joints of the pavement, resulting in immediate rutting and failure of the system. The pavement was subsequently reconstructed with bedding sand that had 0% material passing the No. 200 (0.075 mm) sieve and reported excellent performance. Although gradation is an important factor in drainage (since it affects permeability) eliminating all of the fines can sometimes be impractical. Therefore, ICPI recommends up to 1% passing the No. 200 (0.075 mm) sieve.

Another important material property is permeability. Even specifications that allow up to 3% of fines can result in a five fold decrease in permeability from the lowest to highest percentage passing (Bullen 1998). In research conducted by the Interlocking Concrete Pavement Institute (ICPI 2004) the permeability of “very good to excellent” bedding sands was measured. Using the test method described by ASTM D2434-68 *Standard Test Method for Permeability of Granular Soils (Constant Head)* (ASTM 2006) the permeabilities ranged from 2.8 in./hr (2.1 x 10<sup>-3</sup> cm/second) to 15.6 in./hr (1.1 x 10<sup>-2</sup> cm/second). These values correspond to fines that range from 2.5% to 0% passing the No. 200 (0.075 mm) sieve but, more

Sieve Size	Percent Passing
4.75 mm	100
2.36 mm	90
1.18 mm	70
0.600 mm	47
0.300 mm	20
0.150 mm	7
0.075 mm	0

Table 2. Modified Gradation or Reconstituted Aggregates According to Beaty (1996)



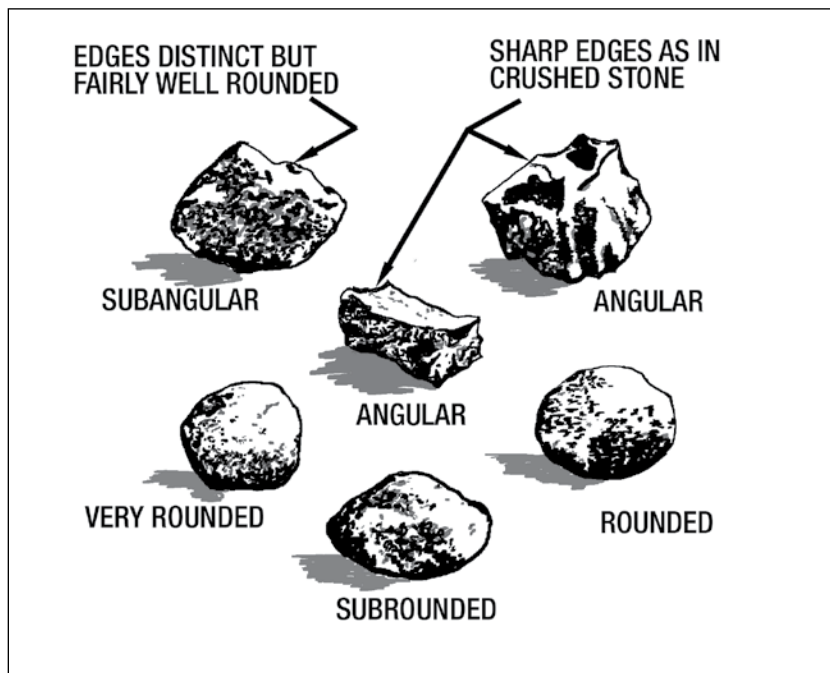


Figure 2. Typical description of coarse grains according to ASTM D 2488

importantly they also are associated with Micro-Deval maximum degradation values of 8%. Table 3 indicates a minimum permeability of 2.8 in./hr ( $2.1 \times 10^{-3}$  cm/second) that should also be considered at the same time as the other primary properties listed.

**Other Material Properties**—Studies have indicated that bedding sand shape plays a role in bedding sand performance. (Knapton 1993) notes that rounded or cubic grains lead to stable sands, whereas more angular grains are frequently associated with sands that fail. The sands tested by ICPI (ICPI 2004) showed that eight of the nine “good to excellent” performing sands were characterized by having a predominance of sub-angular to sub-rounded particle shapes when tested according to ASTM D2488 *Description and Identification of Soils (Visual-Manual Procedure)* (ASTM 2000). Specifiers and contractors should consider bedding sand angularity using Figure 2 as a guide. Figure 3 shows a photograph of one of the ICPI test sands at high magnification. Table 3 suggests that a combined percentage of sub-angular to sub-rounded particles should be a minimum of 60%.

**Geology**—Geology of bedding sands has been noted by a number of studies to play an important role in their performance. For example, bedding sand with quartz mineralogy is preferred over crushed sandstones (Knapton 1993). In the study by the Interlocking Concrete Pavement Institute (ICPI 2004), eight of the nine “good to excellent” performing sands were noted to consist predominately of silica minerals with over 80% of the material either quartz or quartzite. Table 3 recommends a minimum 80/20 ratio of silica/carbonate mineralogy. A tenth sample, included in the study (and noted as poor performing in the field) was characterized as having up

to 50% carbonate content. Petrographic analysis was conducted according to the Ministry of Transportation of Ontario laboratory method MTO LS-616 *Procedure for the Petrographic Analysis of Fine Aggregate* (MTO 1996). ASTM C295 *Standard Guide for Petrographic Examination of Aggregates for Concrete* (2003) offers an alternative test method.

Limestone screenings and stone dust are not recommended for bedding sand. In addition to being unevenly graded and having excessive material passing the No. 200 (0.075 mm) sieve, screenings and stone dust will break down over time from wetting and abrasion due to vehicular loads. Unlike soft limestone screenings and stone dust, hard, durable concrete sand meeting the requirements in Table 3 will not break down easily. Limestone screenings also tend to break down during pavement construction under initial paver compaction. Depressions will eventually appear in the pavement surface with limestone screenings or stone dust.

**Recommended Material Properties**—Table 3 lists the primary and secondary material properties that should be considered when selecting bedding sands for vehicular applications. Bedding sands may exceed the gradation requirement for the maximum amount passing the No. 200 (0.075 mm) sieve as long as the sand meets degradation and permeability recommendations in Table 3. Micro-Deval degradation testing can be replaced with sodium sulfate or magnesium soundness testing as long as this test is accompanied by the other primary material property tests listed in Table 3. Other material properties listed, such as petrography and angularity testing are at the discretion of the specifier and may offer additional insight into bedding sand performance.



Figure 3. Example of sand from the ICPI bedding sand test program with a total combined percentage of sub-angular and sub-rounded particles equal to 65% according to ASTM D2488



Figure 4. A two-man hand pulled screed



Figure 5. Mechanical screeding is the most efficient method of bedding sand installation

**Role of Bedding Sand in Construction**—Provided that the base was installed according to recommended construction practices and tolerances (See *ICPI Tech Spec 2—Construction of Interlocking Concrete Pavements*), the bedding sand ensures that the pavers have a uniform slope and meet surface tolerances without surface undulations or “waviness.”

Sand should be loosely screeded to a uniform thickness of 1 in. (25 mm) to 1 1/2 in. (38 mm), which will compact to a thickness of 3/4 in (19 mm) to 1 1/4 in (31 mm). for vehicular applications. Screeds can either be pulled by hand or by machine (mechanical screed) as shown in Figures 4 and 5. Mechanical screeding provides the most efficient method. Pavers are placed on the loose uncompacted sand. Contractors should select sand that allows the pavers to be uniformly seated during their initial compaction with a minimum 5000 lb (22kN) force plate compactor.

The sand should have sufficient moisture content to allow for adequate compaction. At no times should bedding sand be either “bone dry” or saturated. A moisture content range of 6% to 8% has been shown to be optimal for most sands (Beaty 1992). Contractors can assess moisture content by squeezing a handful of sand in their hand. Sand at optimal moisture content will hold together when the hand is re-opened without shedding excess water. Although it can be

difficult to control the exact moisture content on the job site, uniformity of moisture content can be maintained by covering stock piles with tarps. Digging into sand piles at mid-height to avoid saturated material that may be at the bottom of the pile is also recommended.

While on the job site, a contractor should check the hard-

Material Properties	Test Method	Recommended Maximum or Minimum
<b>Primary Properties</b>		
Gradation	ASTM C 33 CSA A23.1 (FA1)	Maximum 1 % passing No. 200 (0.075 or 0.080 mm) sieve
Micro-Deval Degradation	CSA A23.2-23A ASTM D 7428	Maximum 8%
Constant Head Permeability	ASTM D 2434	Minimum 2 x 10 <sup>-3</sup> cm/second (2.83 in/hr)
<b>Secondary Properties</b>		
Soundness – Sodium Sulfate or Magnesium Sulfate	ASTM C 88	Maximum 7%
Silica (Quartz and Quartzite)/ Carbonate Ratio	MTO LS-616 ASTM C 295	Minimum 80/20 ratio
Angularity and Particle Shape	ASTM D 2488	Minimum 60% combined sub- angular and sub- rounded

Note 1: See “Recommended Material Properties” on page 5 of *ICPI Tech Spec 17*

Note 2: Bedding sand may also be selected based on field performance. Field performance is selected when the specifier or contractor assumes responsibility for the selection and performance of bedding sand not conforming to the properties in Table 3. Field performance as a selection criteria is suggested when the available local materials do not meet the primary material properties suggested in Table 3, but the specifier or contractor can demonstrate to the satisfaction of the owner (or owner’s representative), successful historical field performance. In this case the owner should specify the class of vehicular traffic, and the contractor should verify past field performance of the bedding sand under similar vehicular traffic.

Table 3. Recommended Laboratory Material Properties for Bedding and Joint Sands in Vehicular Applications <sup>1,2</sup>

Primary Properties	Test	Recommended Maximum or Minimum	Construction Tolerance	Frequency of Field Test
Gradation	ASTM C33 and CSA A23.1 (FA1)	See Table 1	Not Applicable	Provided by aggregate supplier every 25,000 sf (2,500 m <sup>2</sup> )
Bedding Layer Thickness	Check with ruler	Nominal 1 in. (25 mm)	± 3/8 in. (10 mm)	By contractor every 5,000 to 10,000 sf (500 to 1000 m <sup>2</sup> )
Hardness	Test with Swiss army pocket knife blade	No broken particles	Not Applicable	By contractor every 25,000 sf (2,500 m <sup>2</sup> )
Secondary Properties	Test	Recommended Maximum or Minimum	Construction Tolerance	Frequency of Field Test
Moisture content at time of installation	Hand test	Holds together without shedding water	Not applicable	While screeding

Table 4. Recommended Installation Properties for Bedding Sands in Vehicular Applications

ness of the bedding sand particles. Particles of sufficient hardness will not break under the pressure of a Swiss Army pocket knife. This field test, although not recommended for pre-selection of bedding sands, helps assess a material at the time of delivery. Table 4 lists the recommended bedding sand properties that need to be considered by a contractor during installation.

Interlocking concrete pavements should also be designed and constructed such that the bedding sand should not be able to migrate into the base, or laterally through the edge restraints. Dense-graded base aggregates with 5% to 12% fines (the amount passing the No. 200 or 0.075 mm sieve), will ensure that the bedding sand does not migrate down into the base surface. For pavements built over asphalt or con-



Figure 7. Woven geotextile used to contain bedding sand from migrating laterally. Visit [www.icpi.org](http://www.icpi.org) for detail drawings.

crete bases, it is necessary to provide adequate drainage by providing 2 in. (50 mm) diameter weep holes around the perimeter on 10 ft (3 m) centers and at the low points in the concrete base to drain excess water from the bedding layer. Holes should be filled with washed pea gravel and covered with geotextile to prevent the loss of bedding sand. Figure 6 on the next page shows a detail. Specifiers can visit the ICPI website to download similar details for use in specifications from [www.icpi.org](http://www.icpi.org). To control lateral loss of bedding sand, Figure 7 shows geotextile installed at the interface of a concrete curb. To ensure that the sand cannot migrate

through the joints in the curb woven geotextile is placed on top of the aggregated base, extending approximately 1 ft. (300 mm) into the pavement and wrapped up the sides of the curb to fully contain the bedding sand.

### Role of Jointing Sand

Jointing sand provides two primary functions in a segmental concrete pavement; it creates interlock and helps seal the pavement. ICPI recommends that the same material properties listed in Table 3 also apply to jointing sand. Panda and Ghosh (2002) describe laboratory research on pavements using fine and coarse joint sands. Simulated loading consisted of 11-kip (51 kN) over 80 mm pavers with varying joint widths and joint sand gradations. Deflection of the pavement was then measured with coarser sand exhibiting lower deflections. The study concluded that “the coarser the sand, the better the performance.” The coarser sands used in the study correspond to the gradations for Joint Sand listed in Table 1 and the study recommended joint widths up to 3/16 in. (5mm). ICPI recommends joint widths of 1/16 to 3/16 (2 mm to 5 mm).

Contractors can benefit from using one sand source. There are advantages to using the bedding material for the jointing sand during construction. Using one material allows the contractor to monitor and control one sand product on the job site. Over time the joints become filled with detritus, providing some degree of sealing. Regardless of the sand used, segmental concrete pavements will always allow some water penetration through the joints.



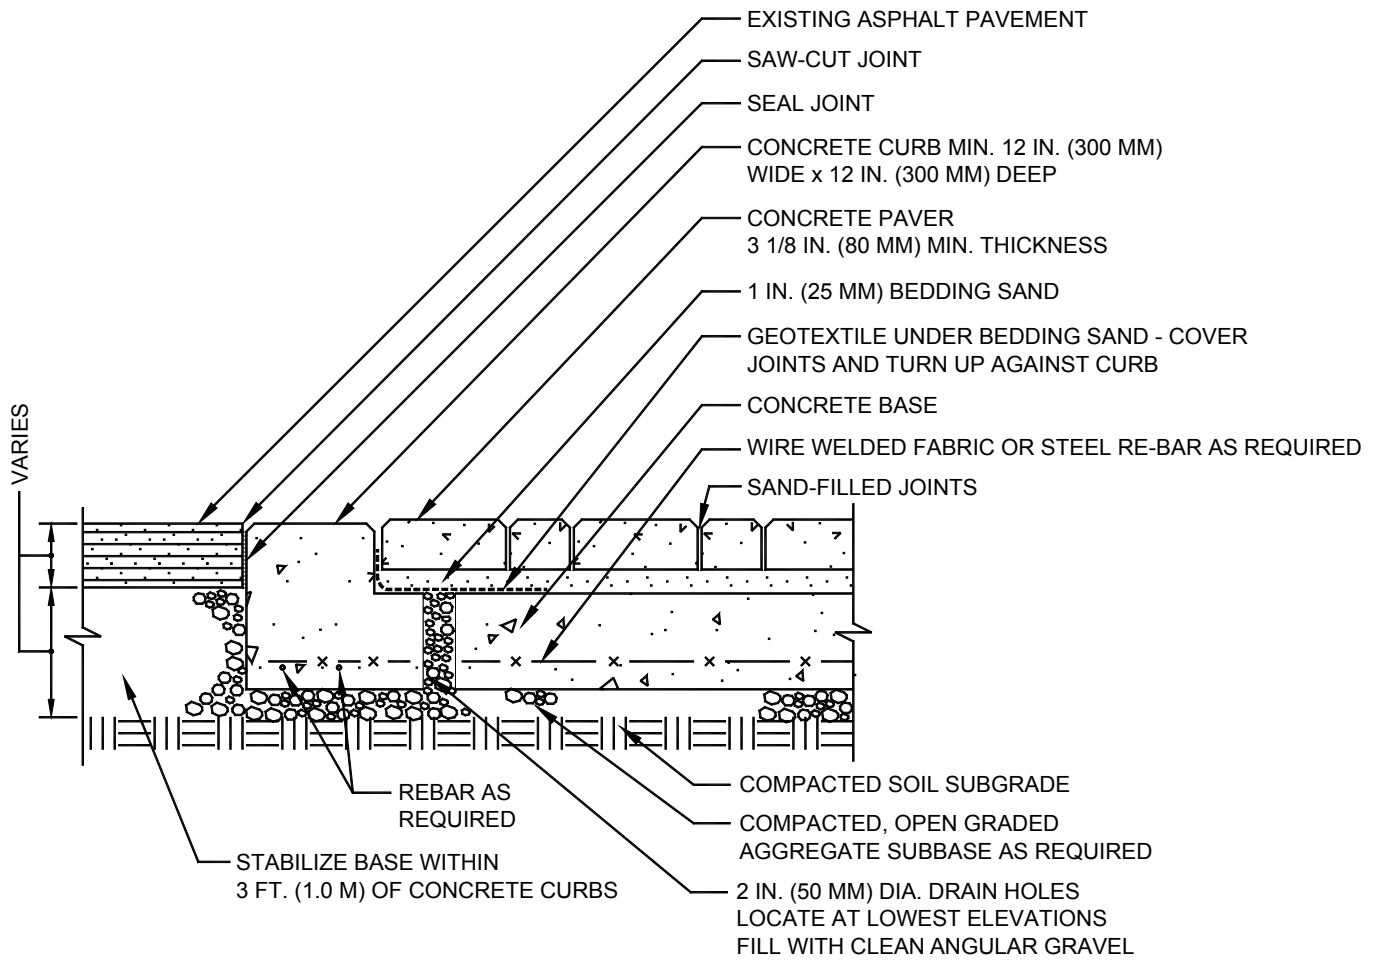


Figure 6. Recommended detail for sand set pavers over a concrete base. Drainage holes provide drainage for water that enters the bedding layer through the joints. The same detail applies for paver overlays on asphalt.

Coarse bedding sand may require additional effort to place it in the joints. In some cases, smaller joint widths may require the use of finer graded sand. In this case, the use of mortar sand is recommended. Mortar sand should conform to the gradations of either ASTM C 144 or CSA A179 but should also meet the material property requirements of Table 3.

Although joint sand selection is an important factor, design and construction play a more important role. Considerations such as joint width, ensuring that the sand is swept in dry, degree of compaction, and ensuring the joints are completely filled, are just as critical to the long term success of pavement performance. Information on joint sand installation can be found in *ICPI Tech Spec 2—Construction of Interlocking Concrete Pavements* (ICPI 2004).

## References

- ICPI Tech Spec 4—Structural Design of Interlocking Concrete Pavements for Roads and Parking Lots*, ICPI Washington, DC, 2004.
- CSA A23.1 (FA1) *Concrete Materials and Methods of Concrete Construction, Table 4 Grading Limits for Fine Aggregates*, Canadian Standards Association, Toronto, Ontario, Canada, 2004.
- Knapton J., "Paver Laying Course Materials – State of the Art" in *Proceedings of the 2nd International Workshop on Concrete Block Paving*, Oslo, Norway, pp. 246 – 264, 1994.
- Lilley A.A. and Dowson A.J., "Laying Course Sand for Concrete Block Paving" in *Proceedings of the 3rd International Conference on Concrete Block Paving*, Rome, Italy, pp. 457-462, 1988.



- Beaty A.N.S. "Laying Course Materials: Specification and Performance," in *Proceedings of the 5th International Conference on Concrete Block Paving*, Tel Aviv, Israel, pp. 129-139, 1996.
- ASTM C 88 Soundness of Aggregate by use of Sodium Sulfate or Magnesium Sulfate, *Annual Book of ASTM Standards*, Vol. 4.02, American Society for Testing and Materials, Conshohocken, Pennsylvania, 2005.
- Jayawickrama, Hossain and Phillips, *Evaluation of Aggregate Durability Using Micro-Deval Test*, Transportation Research Board 2006 Annual Meeting, 2006.
- CSA A23.2-23A, *The Resistance of Fine Aggregate to Degradation by Abrasion in the Micro-Deval Apparatus*, Canadian Standards Association, Toronto, Ontario, Canada, 2004.
- ASTM D 6928 Standard Test Method for Resistance of Coarse Aggregate to Degradation by Abrasion in the Micro Deval Apparatus, *Annual Book of ASTM Standards*, Vol. 4.03, American Society for Testing and Materials, Conshohocken, Pennsylvania, 2006.
- ICPI *Bedding Sand Laboratory Testing*, File no. L04-0127AT, DAVROC Testing Laboratories, ICPI Herndon, VA, USA 2004.
- ICPI 1997, *Port and Industrial Pavement Design with Concrete Pavers*, Second Edition, ICPI Herndon, VA, 1997.
- Knapton J., *The Nature and Classification of Bedding Sand*, Proc. BIBM 1993, pp 135-141, Washington, DC, 1993.
- Bullen F. and Knapton J., "The Role of Bedding Sands in Segmental Paving Instability," in *Proceedings of the 3rd International Workshop on Concrete Block Paving*, Cartagena, Colombia, May 10-13, 1998 pp. 36-1 to 36-4, 1998.
- ASTM D 2434-68 Permeability of Granular Soils (Constant Head), *Annual Book of ASTM Standards*, Vol. 4.08, American Society for Testing and Materials, Conshohocken, Pennsylvania, 2006.
- ASTM D 2488 Description and Identification of Soils (Visual-Manual Procedure), *Annual Book of ASTM Standards*, Vol. 4.08, American Society for Testing and Materials, Conshohocken, Pennsylvania, 2000.
- MTO LS – 616 *Procedure for the Petrographic Analysis of Fine Aggregate*, Ministry of Transportation Ontario, Downsview Ontario, Canada, 2005.
- ASTM C 295 Standard Guide for Petrographic Examination of Aggregates for Concrete, *Annual Book of ASTM Standards*, Vol. 4.02, American Society for Testing and Materials, Conshohocken, Pennsylvania, 2003.
- ICPI *Tech Spec 2—Construction of Interlocking Concrete Pavements* ICPI, Herndon, VA, 2004.
- Beaty, A., "Predicting the Performance of Bedding Sands," in *Proceedings of the 4th International Conference on Concrete Block Paving*, Auckland, New Zealand, pp. 273-284, 1992.
- Panda and Ghosh, "Structural Behavior of Concrete Block Paving—Sand in Bed and Joints," *Journal of Transportation Engineering*, March 2002.
- ASTM C 144 Standard Specification for Aggregate for Masonry Mortar, *Annual Book of ASTM Standards*, Vol. 4.05, American Society for Testing and Materials, Conshohocken, Pennsylvania, 2002.
- CSA A 179 *Mortar and Grout for Unit Masonry*, Canadian Standards Association, Toronto, Ontario, Canada, 2004.
- ASTM D 7428-08 Standard Test Method for Resistance of Fine Aggregate to Degradation by Abrasion in the Micro-Deval Apparatus, *Annual Book of ASTM Standards*, Vol. 4.03, American Society for Testing and Materials, Conshohocken, Pennsylvania, 2008.



Interlocking Concrete  
Pavement Institute®

14801 Murdock Street  
Suite 230  
Chantilly, VA 20151

Tel: 703.657.6900  
Fax: 703.657.6901  
E-mail: [icpi@icpi.org](mailto:icpi@icpi.org)  
[www.icpi.org](http://www.icpi.org)

In Canada:  
P.O. Box 1150  
Uxbridge, ON L9P 1N4  
Canada

*The content of ICPI Tech Spec technical bulletins is intended for use only as a guideline. It is not intended for use or reliance upon as an industry standard, certification or as a specification. ICPI makes no promises, representations or warranties of any kind, expressed or implied, as to the content of the Tech Spec Technical Bulletins and disclaims any liability for damages resulting from the use of Tech Spec Technical Bulletins. Professional assistance should be sought with respect to the design, specifications and construction of each project.*

*BOD Approved: February 2018*